




WW

Las



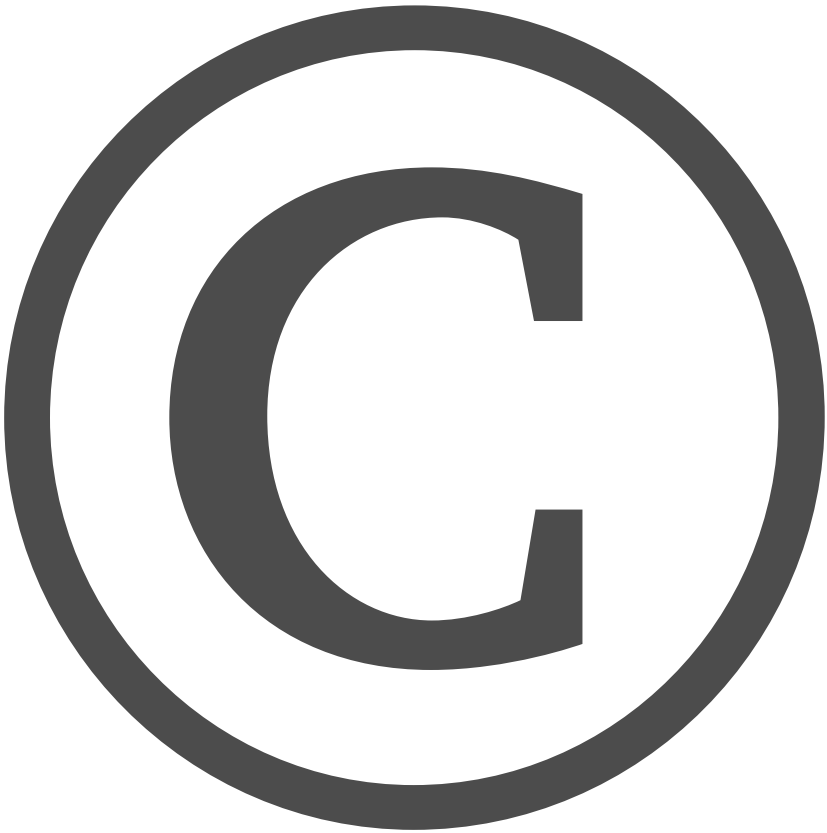

in

Ka

La

Lu

24



W



Co

Co

Ec

Th



WW

Las









P



1.

Li

Gr

Fi

Ru

Di

1.

CO

CO

CO

CI



WW

Las



Ar



Re

1.

Op

In

Th

1.

Re

De

Ar

Pr

H

Pr

Di

In

Co

1.

1.

No

Dy

1.

W



WW

Las



1.

1.

1.

24

48

In

Pe

Co

1.

W

St

In

W

sR

Ac

Pr

Se

Co

Ou

Pr

IT

Ou

Co

Co



WW

Las



1.

Lo

Ti

JP

JP

DM

PL

1.

Zo



2.

2.

Co

St

Fl

St

Sp

Fr

Fr

Au

M



WW

Las



Sa

Ap

Au

Pr

St

2.

2.

2.



3.

3.

3.

3.



WW

Las





4.

In

In

Ba

Ba

Pr

Au

4.

Sc

Pr

C1

Fl

W

4.

4.

Ba

Au

Sc

4.



WW

Las



4.

W

4.

4.

Th

Op

VI

Ac

VI

Ac

4.

4.

Us



5.

To

Im

Lo



WW

Las



Hi

C1

C1

In

5.

5.

Fi

Hi

5.

Op

Hi

Sh

Se

Bu

Co

5.

To

Re

M

Re

Si

Co

5.



WW

Las



Di

Se

5.

Hi

Lo

Co

5.

5.

Tw

5.

US

Sh

5.

M

5.

Ne

Ne

5.

Au

5.

5.



WW

Las





6.

Au

6.

6.

6.

Se

Ac

Co

Pr

6.

6.

6.

6.

Au

M

6.



WW

Las



Ka

W

It





WW

Las

It

Ka

W



Vie



WW

Las



Th

Si

W

Principle

Implementation


Handling



WW

Las



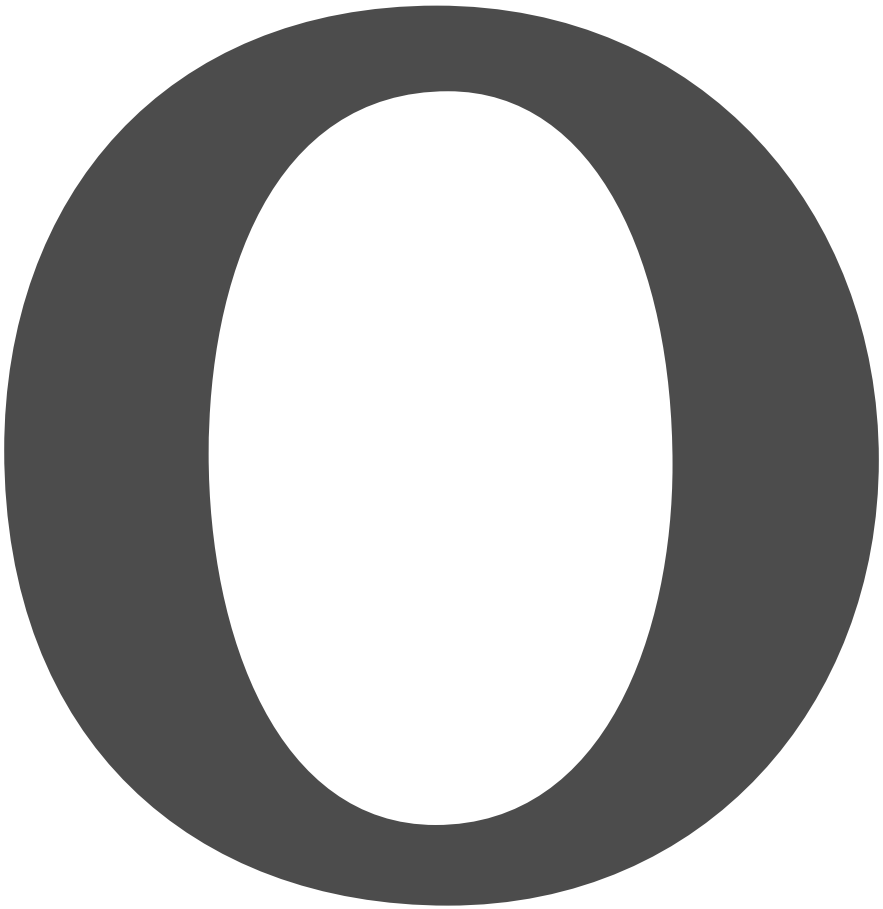

W

Th

Th


£20
Bank of England
SAMPLE
LONDON
FOR THE GOVERNOR AND COMPANY OF
THE BANK OF ENGLAND
CHIEF CASHIER
Twenty
Pounds
20

1.



Int






WW

Las


£20
Bank of England
SAMPLE
I PROMISE TO PAY THE BEARER ON DEMAND THE SUM OF TWENTY POUNDS
LONDON
FOR THE GOVERNOR AND COMPANY OF
THE BANK OF ENGLAND
CHIEF CASHIER
Twenty
Pounds
© THE GOVERNOR AND COMPANY OF THE BANK OF ENGLAND 2006

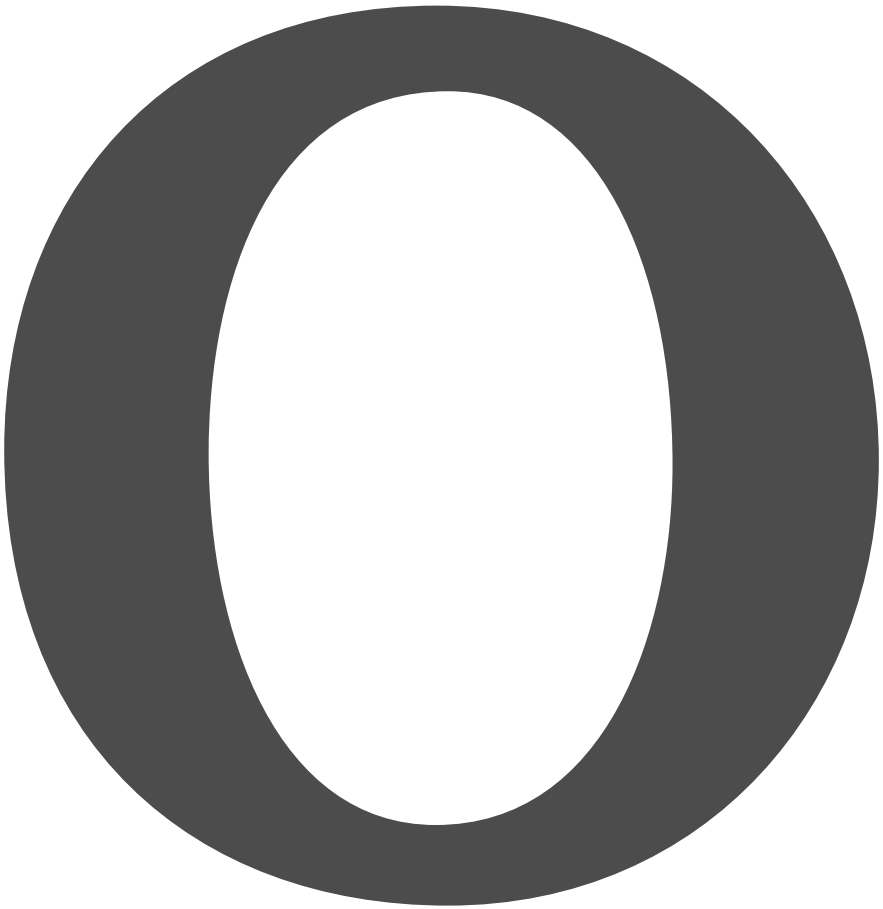

Op

W

Th


BANK OF ENGLAND

Zo





WW

Las



Th

In



WW

Las

M

Fr

Yo

Fr

In

Co

AL

Ad

Fro



WW


Las



Th

In

Th

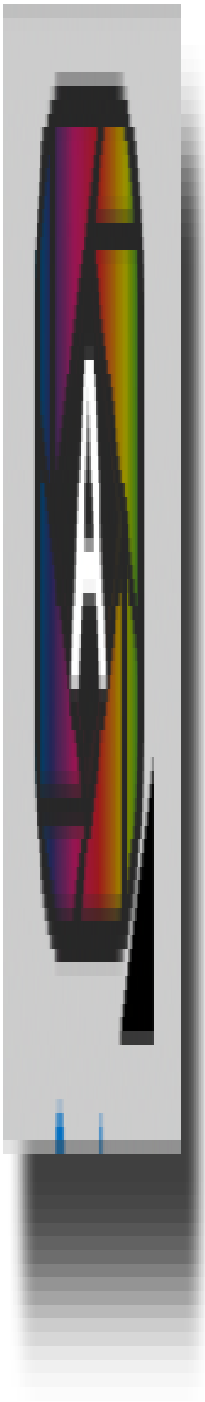


1


2

3






WW

Las



M

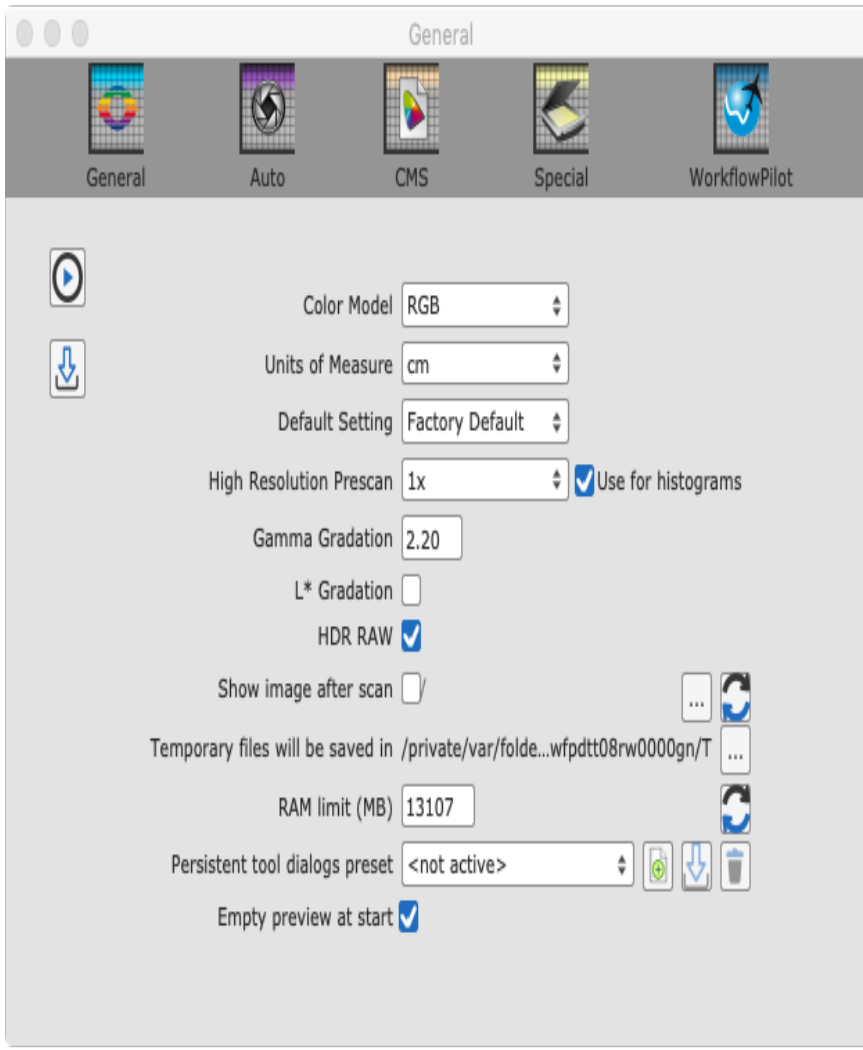

General
General
Auto
CMS
Special
WorkflowPilot
Color Model
RGB
Units of Measure
cm
Default Setting
Factory Default
High Resolution Prescan
1x
Use for histograms
Gamma Gradation
2.20
L* Gradation
HDR RAW
Show image after scan
Temporary files will be saved in
/private/var/folde...wfpdtt08rw0000gn/T
RAM limit (MB)
13107
Persistent tool dialogs preset
<not active>
Empty preview at start

Pre







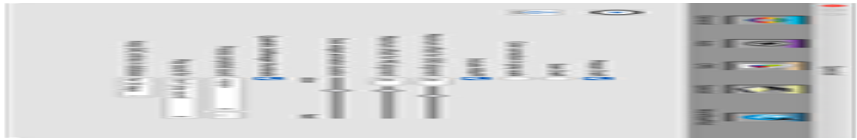







WW

Las



A

Th



3.





WW

Las





WW

Las

B

Ra

Ap

W









WW


Las

Pr

Ba





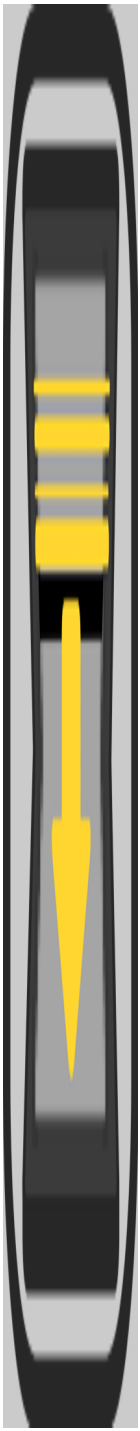

B



HDR
RAW

LSU
TIGERS



WW


Las



W

Category	Function	Start	Tool
Color management	Select film type and exposure		NegaFix (for negatives)
	Scanner calibration		IT8-Calibration
	Printer calibration		Printer Calibration

To

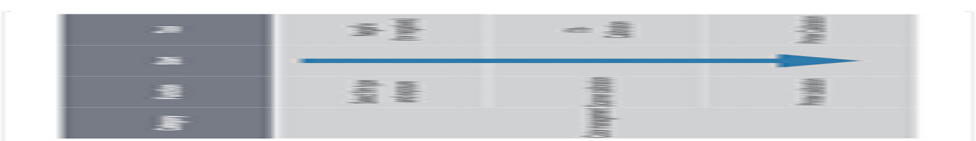









WW

Las

Th


Th

W

Th



Or

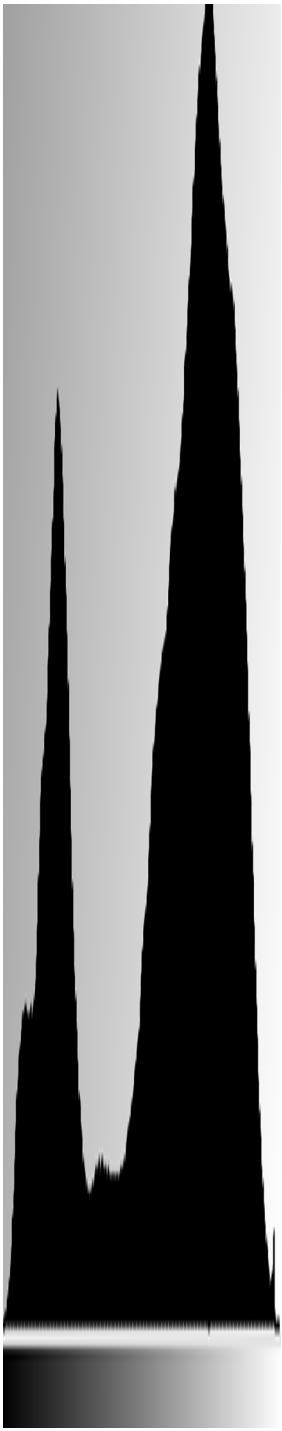








Or

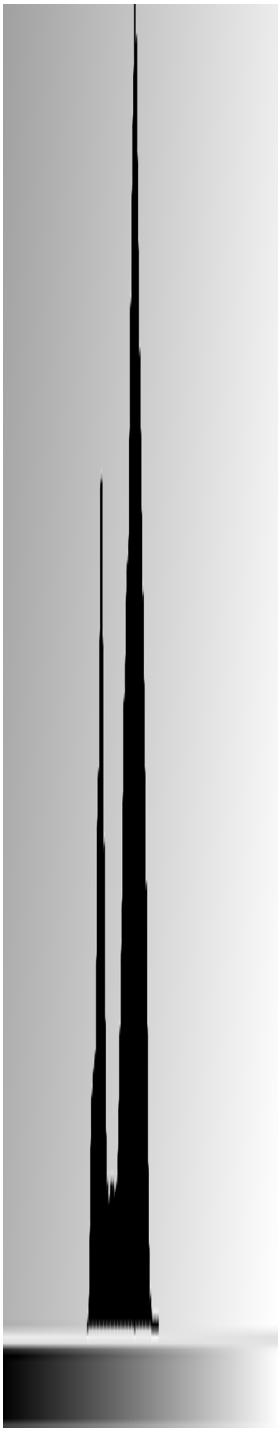








WW

Las

In



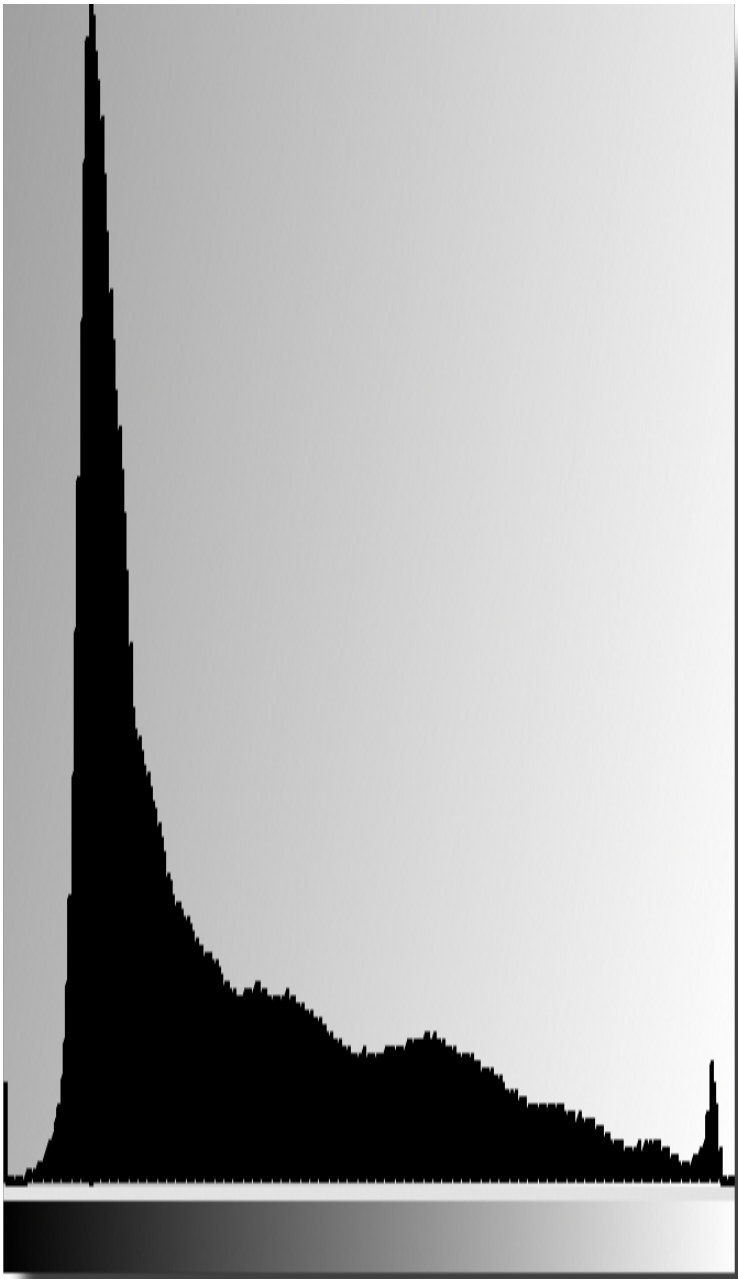







Th

Du



WW

Las



If


Th

In

Se

Se

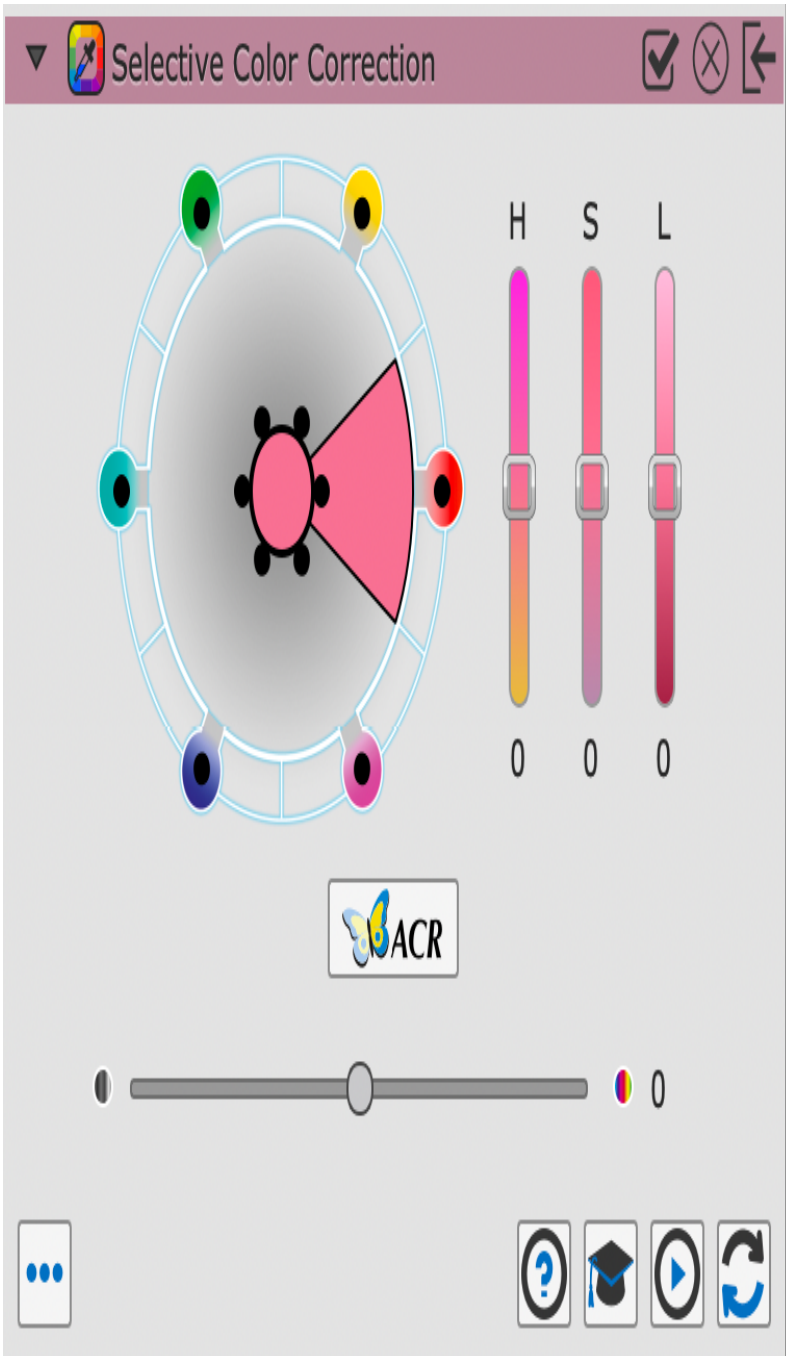


Selective Color Correction
H
S
L
0
0
0
ACR
0



5.



WW


Las

In

Th

In

Th

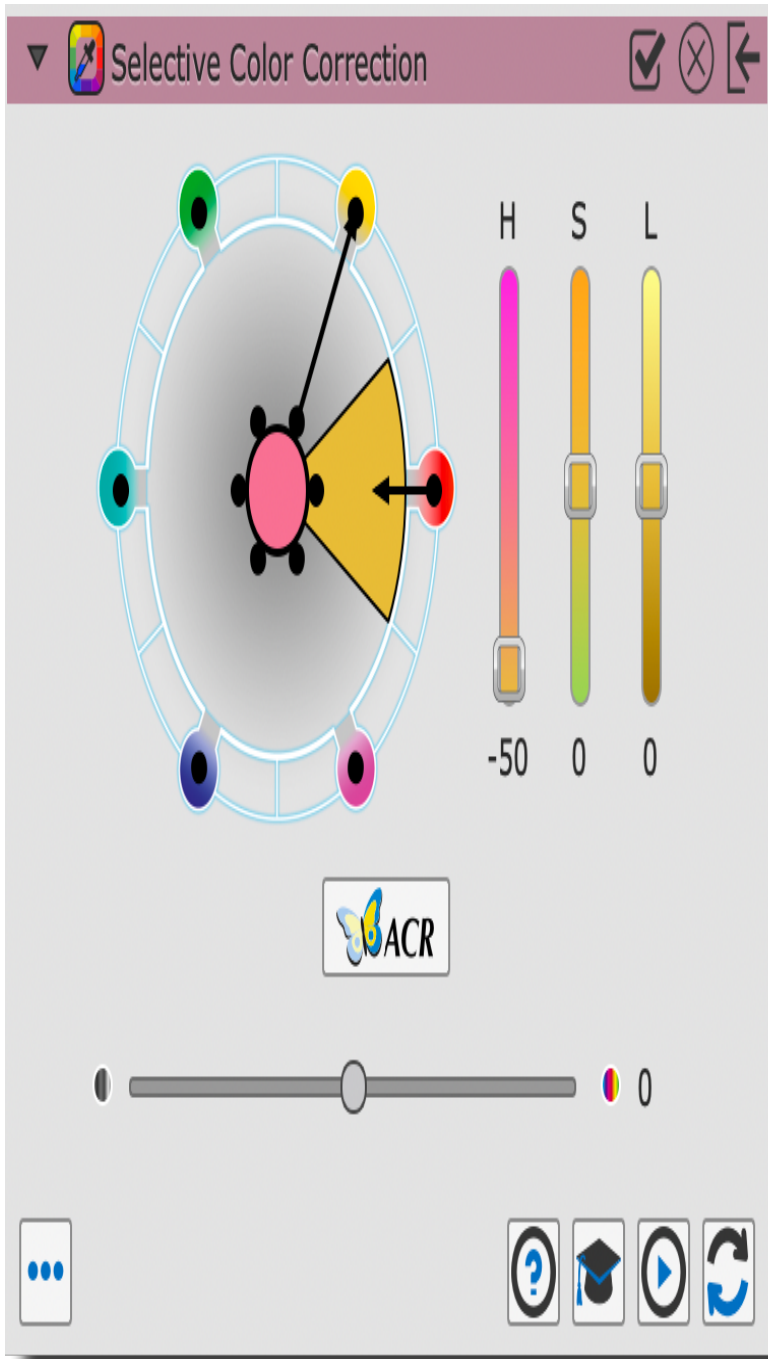
Selective Color Correction
H
S
L
-50
0
0
ACR
0












WW

Las

Th

In

W

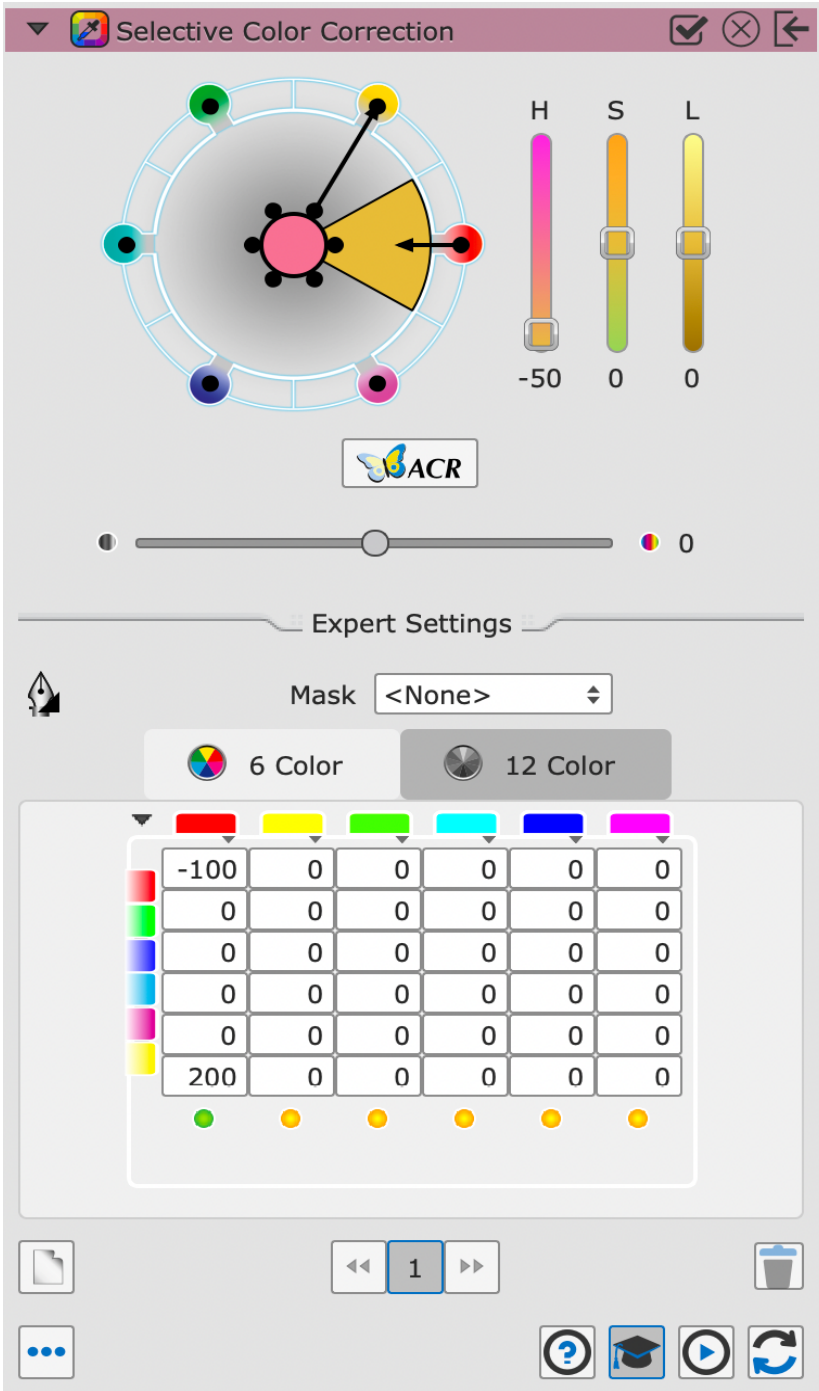
Selective Color Correction
H
S
L
-50
0
0
ACR
0
Expert Settings
Mask
<None>
6 Color
12 Color
-100 0 0 0 0 0
0 0 0 0 0 0
0 0 0 0 0 0
0 0 0 0 0 0
0 0 0 0 0 0
200 0 0 0 0 0
1



WW

Las


Th

Th

To

Th




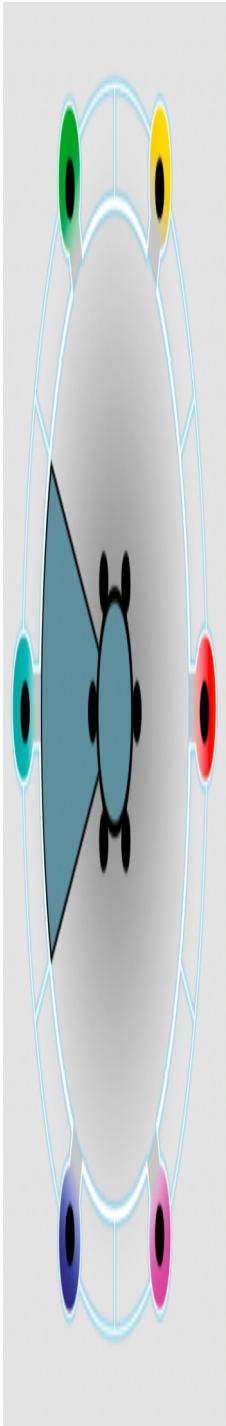







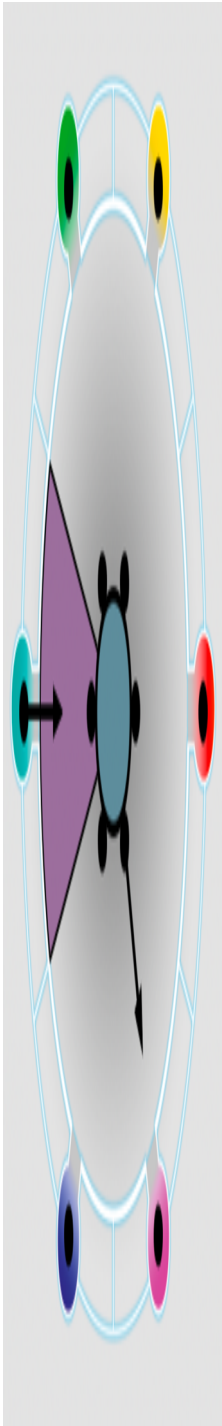







WW

Las


Th

Th

H



to

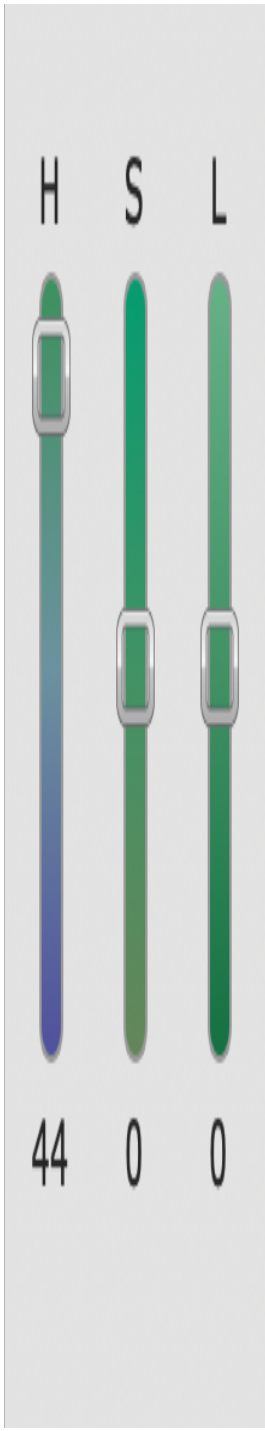
H
S
L
44
0
0

Sa






Lu



br

Th

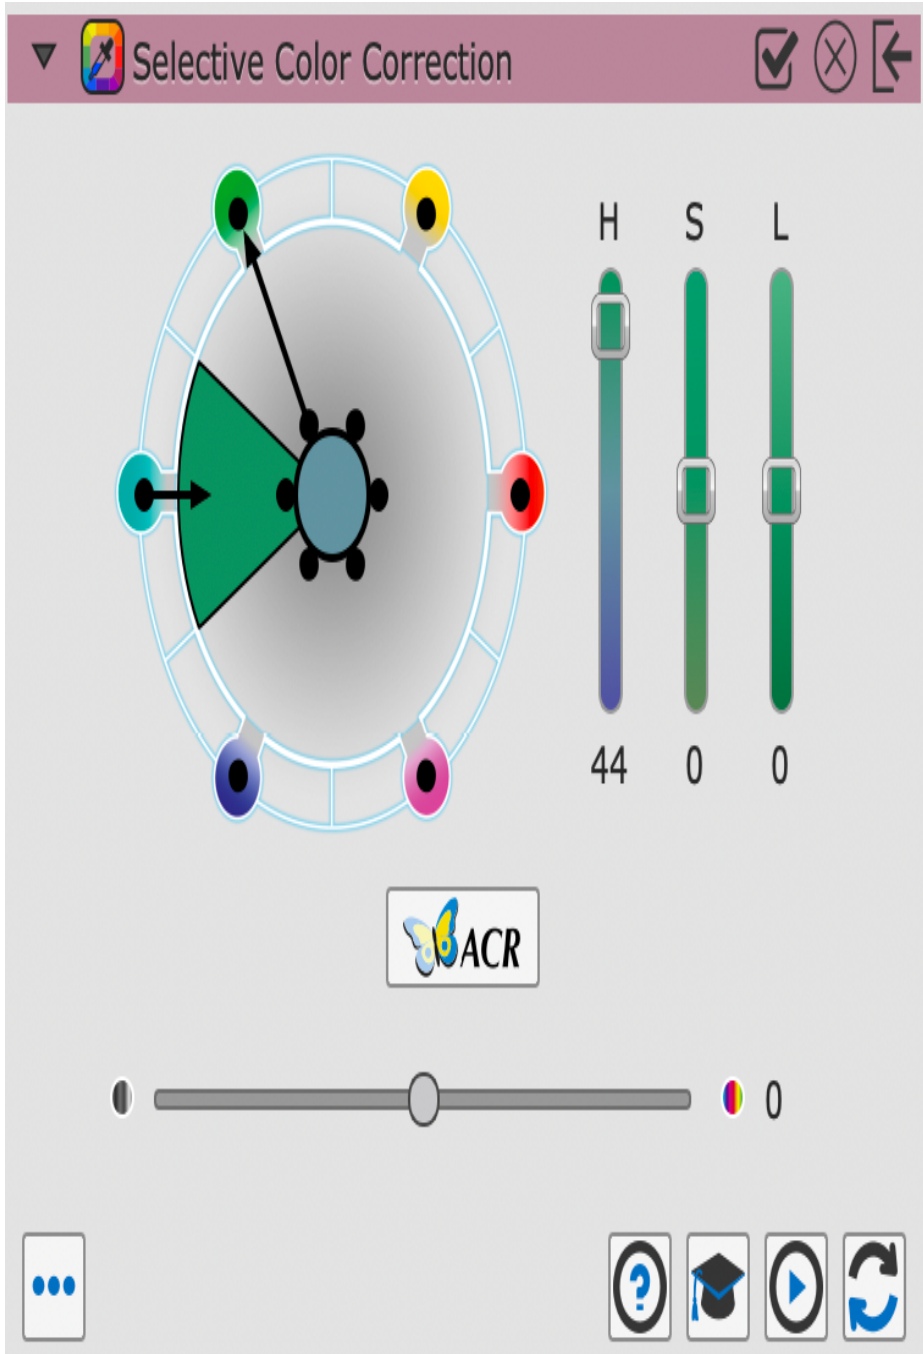


Selective Color Correction
H
S
L
44
0
0
ACR
0



WW

Las



Th

No

W



WW

Las







Fi

Ph

Si



Du

iSRD

6.



WW


Las

To


Sw


In

Co



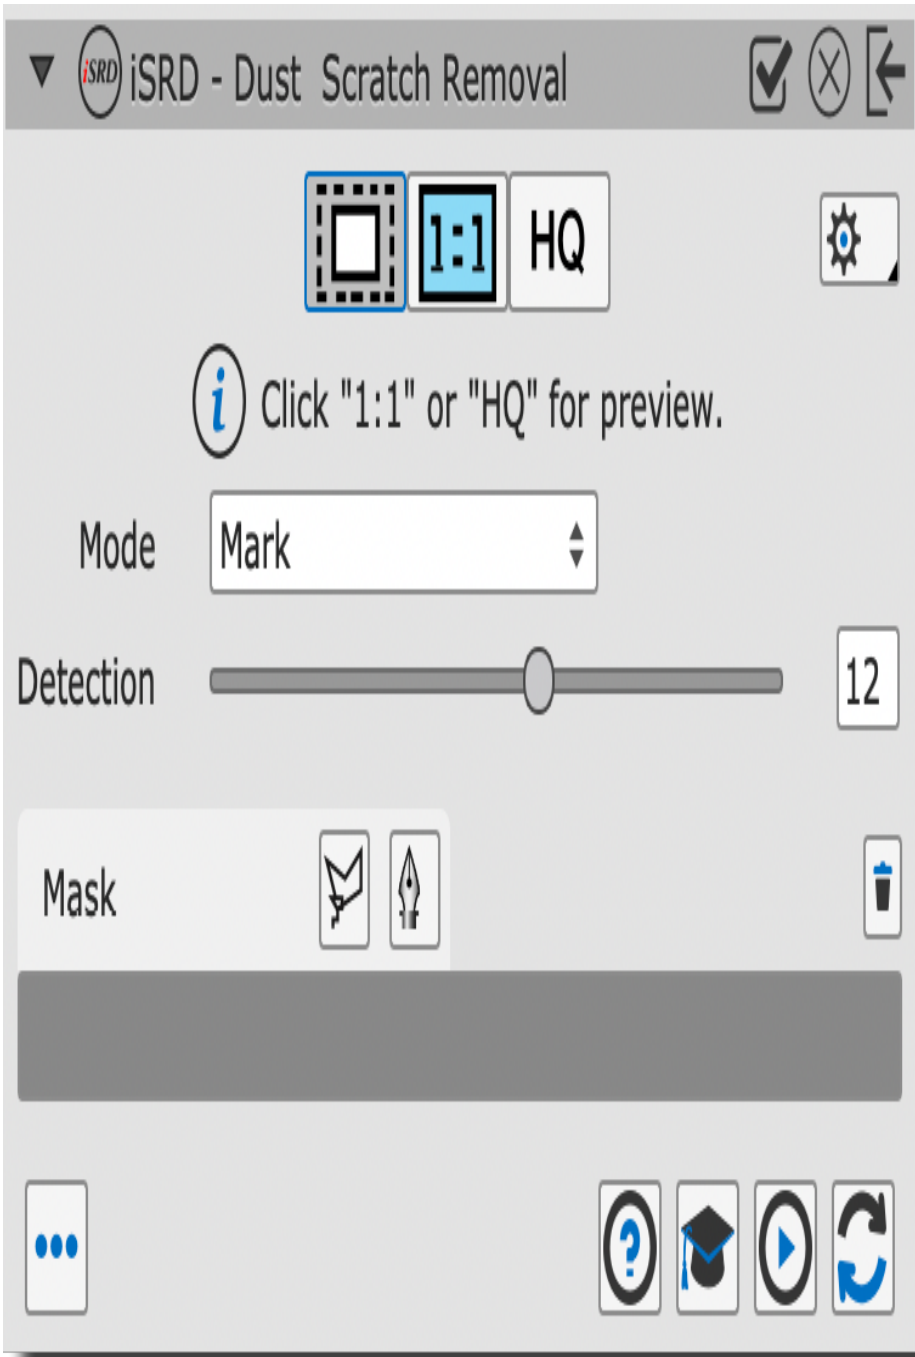


iSRD - Dust Scratch Removal
1:1
HQ
Click "1:1" or "HQ" for preview.
Mode
Mark
Detection
12
Mask

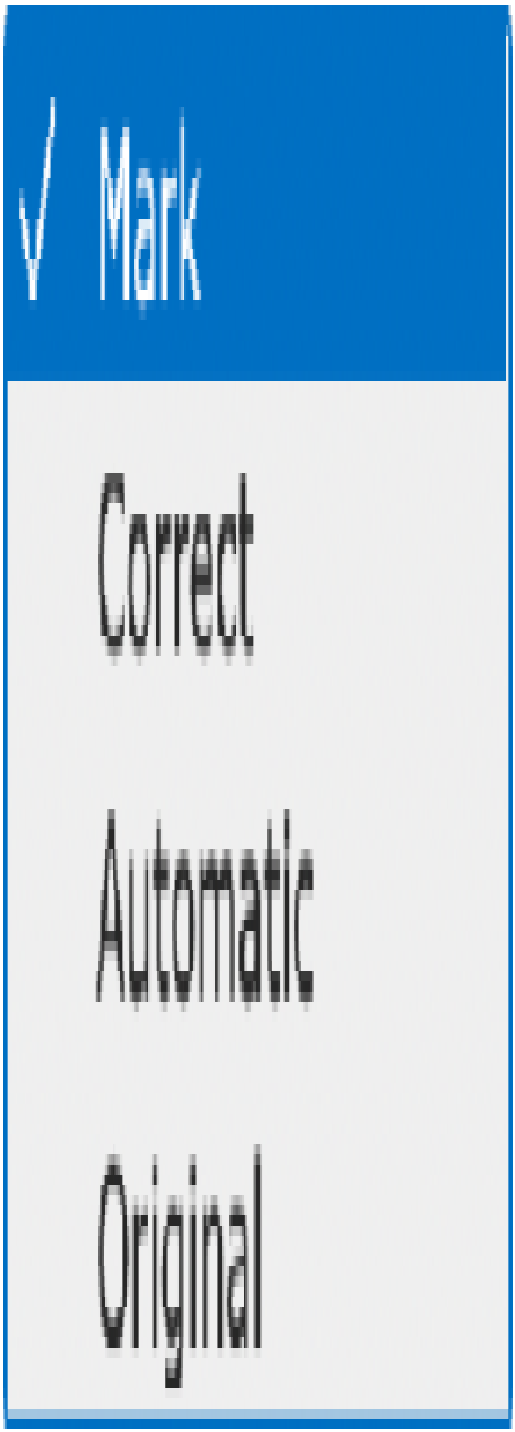
√ Mark
Correct
Automatic
Original



Re



WW


Las




Th

In

Si

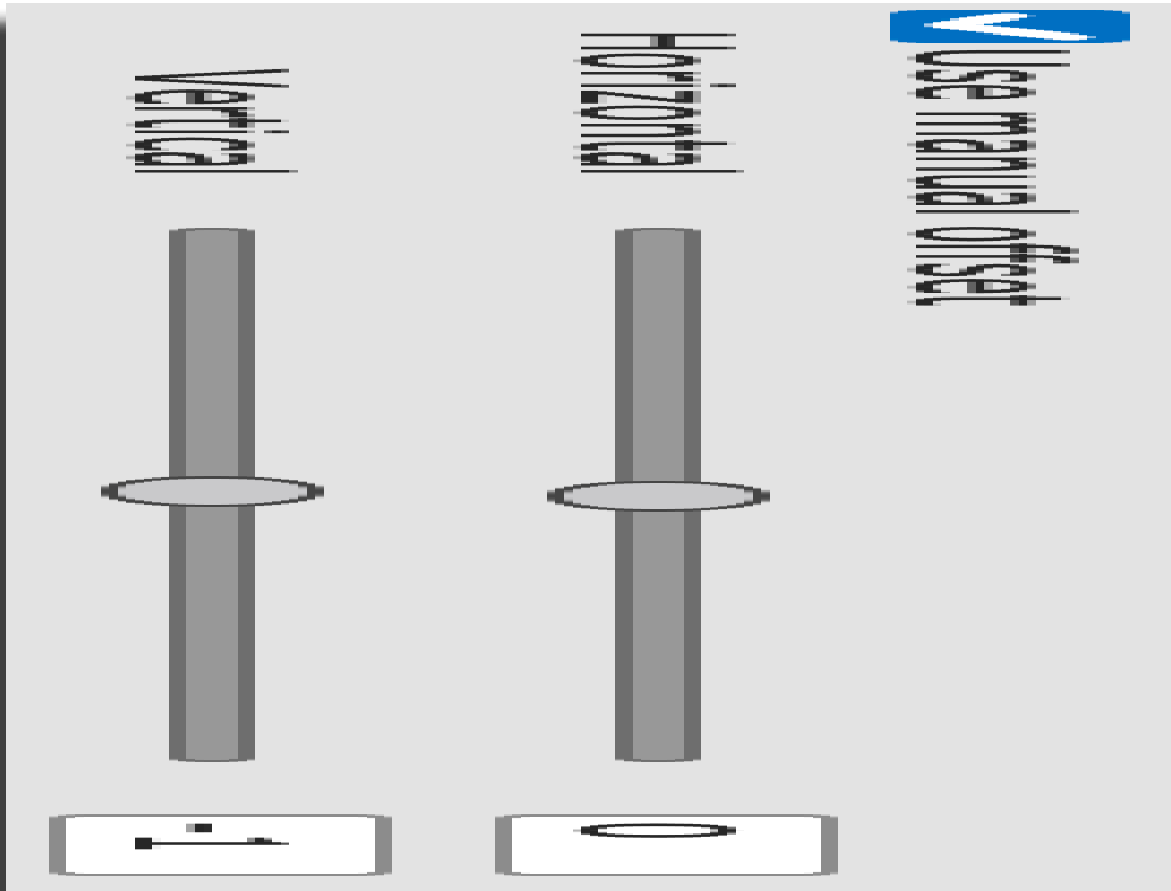

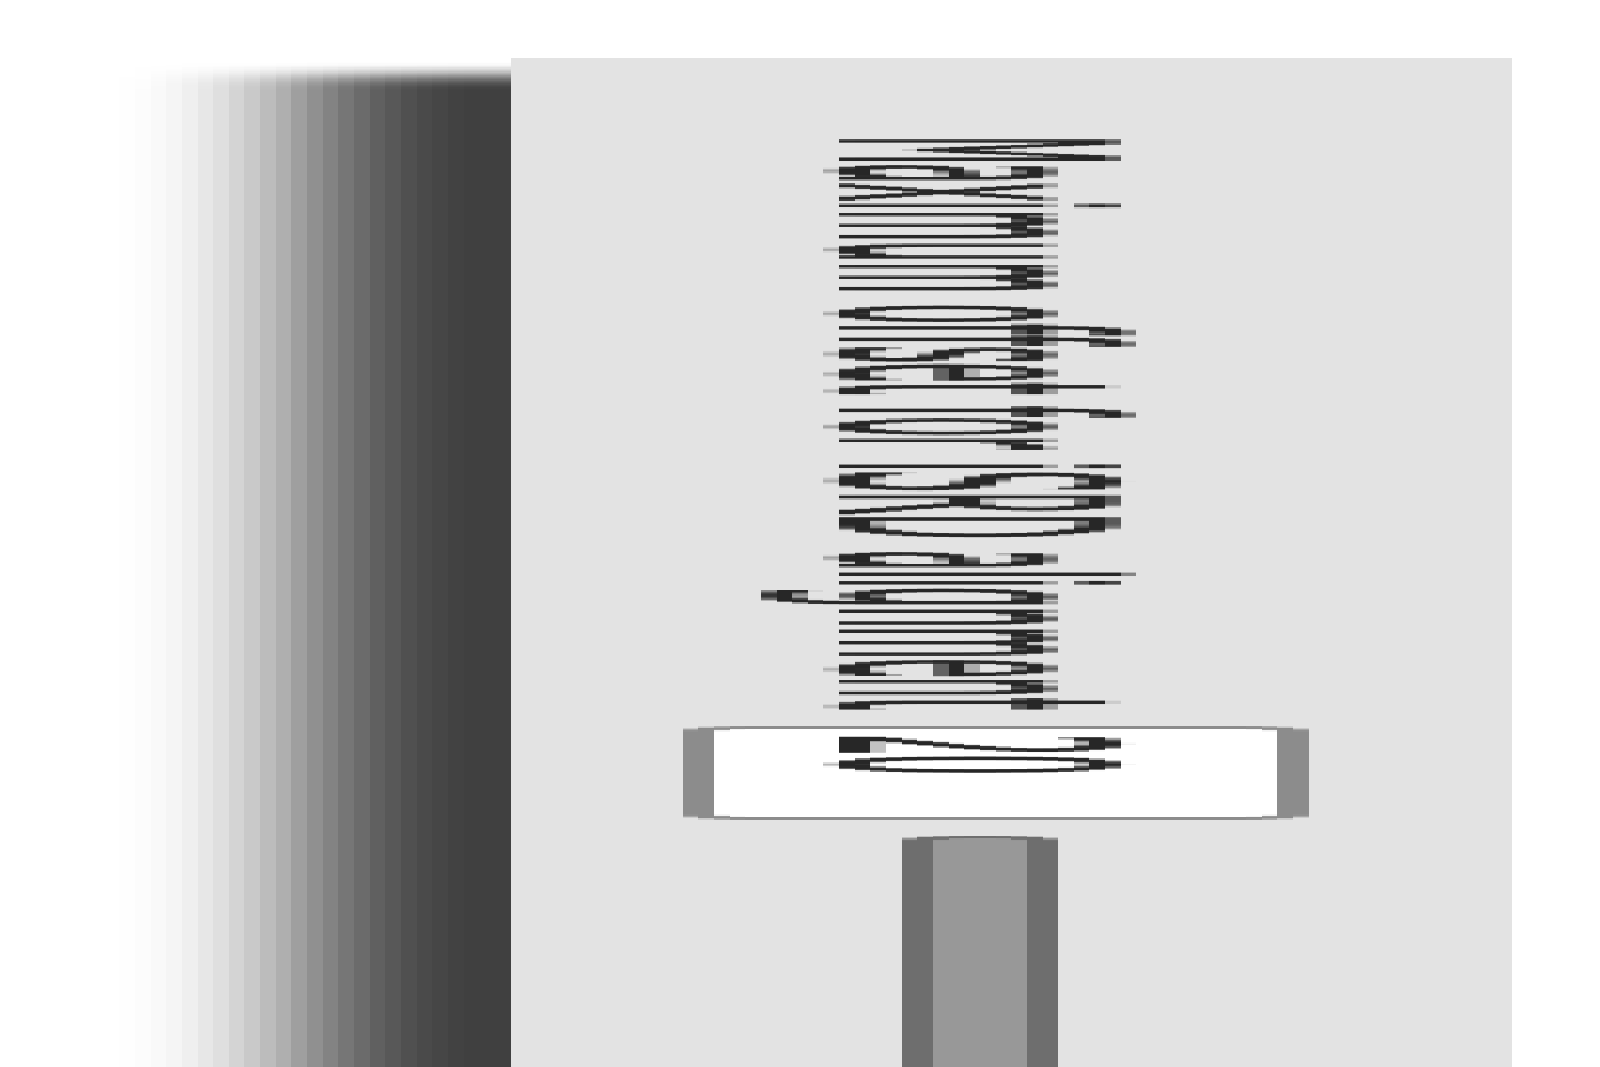



RG





Vis

Vis





